


930 Madison Avenue

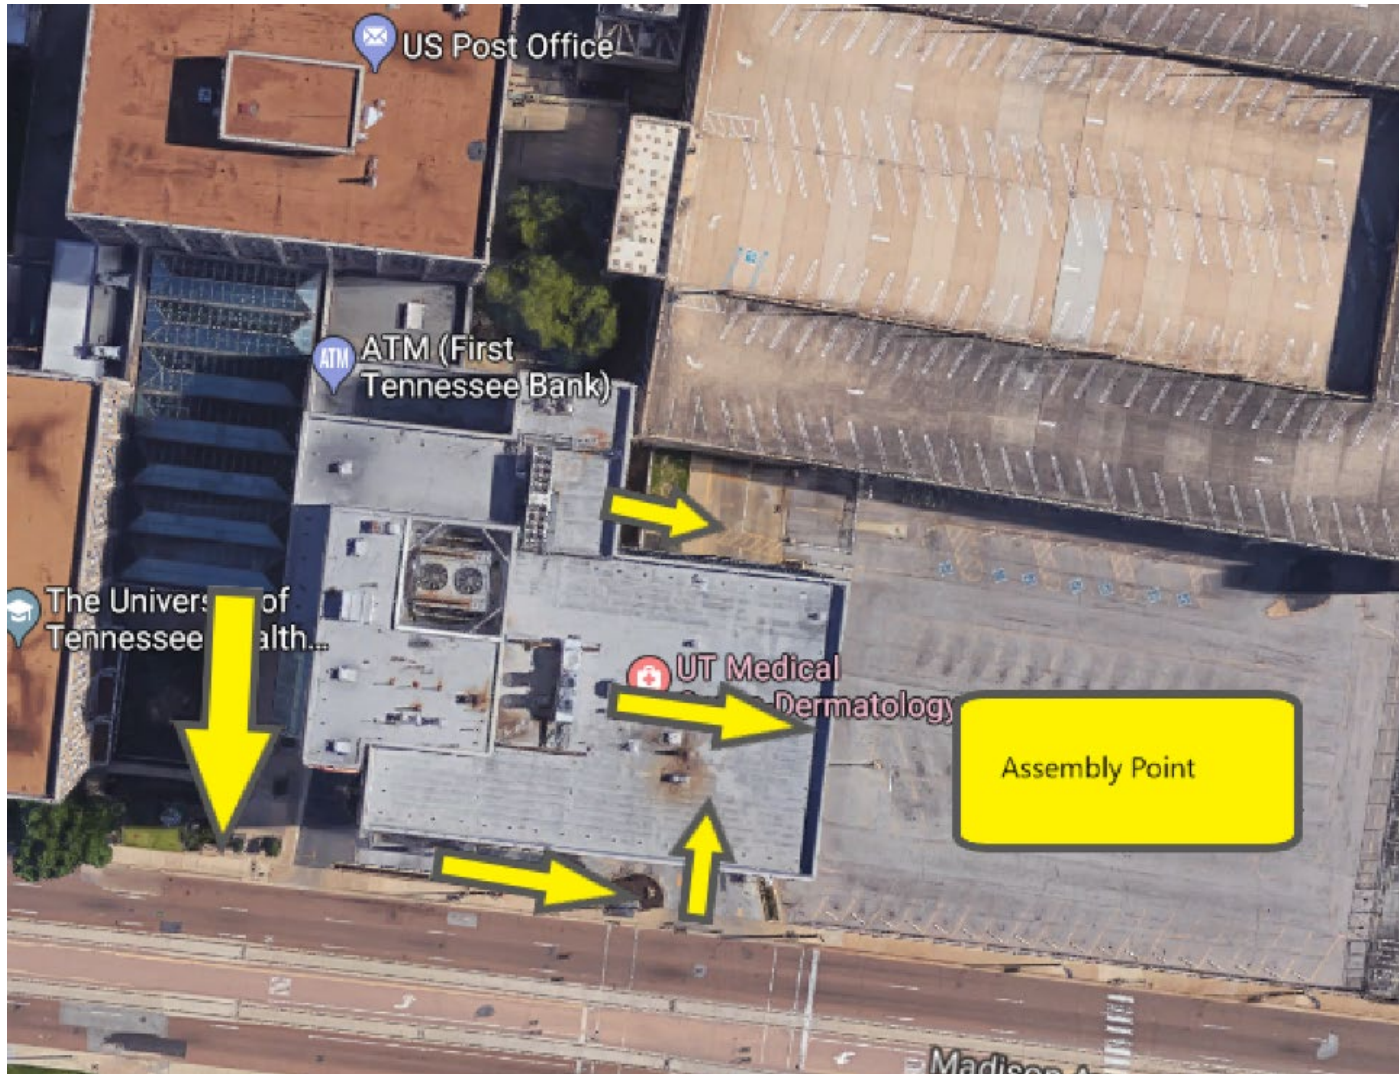

Notes on Evacuation Procedures:

The Fire Alarm system that is located this building is set as a Selective Voice Evacuation System. When one fire detection device is activation, the device will sound the fire alarm speakers/strobes on that floor and two floors above and two floors below. When there are two or more fire alarm devices in fire alarm then fire alarm speakers/strobes will signal evacuation on all floors of the building.

The evacuation procedure for the 3rd floor surgical center calls for personnel to shelter-in-place in the event of a fire alarm.